


PLAN DETAIL

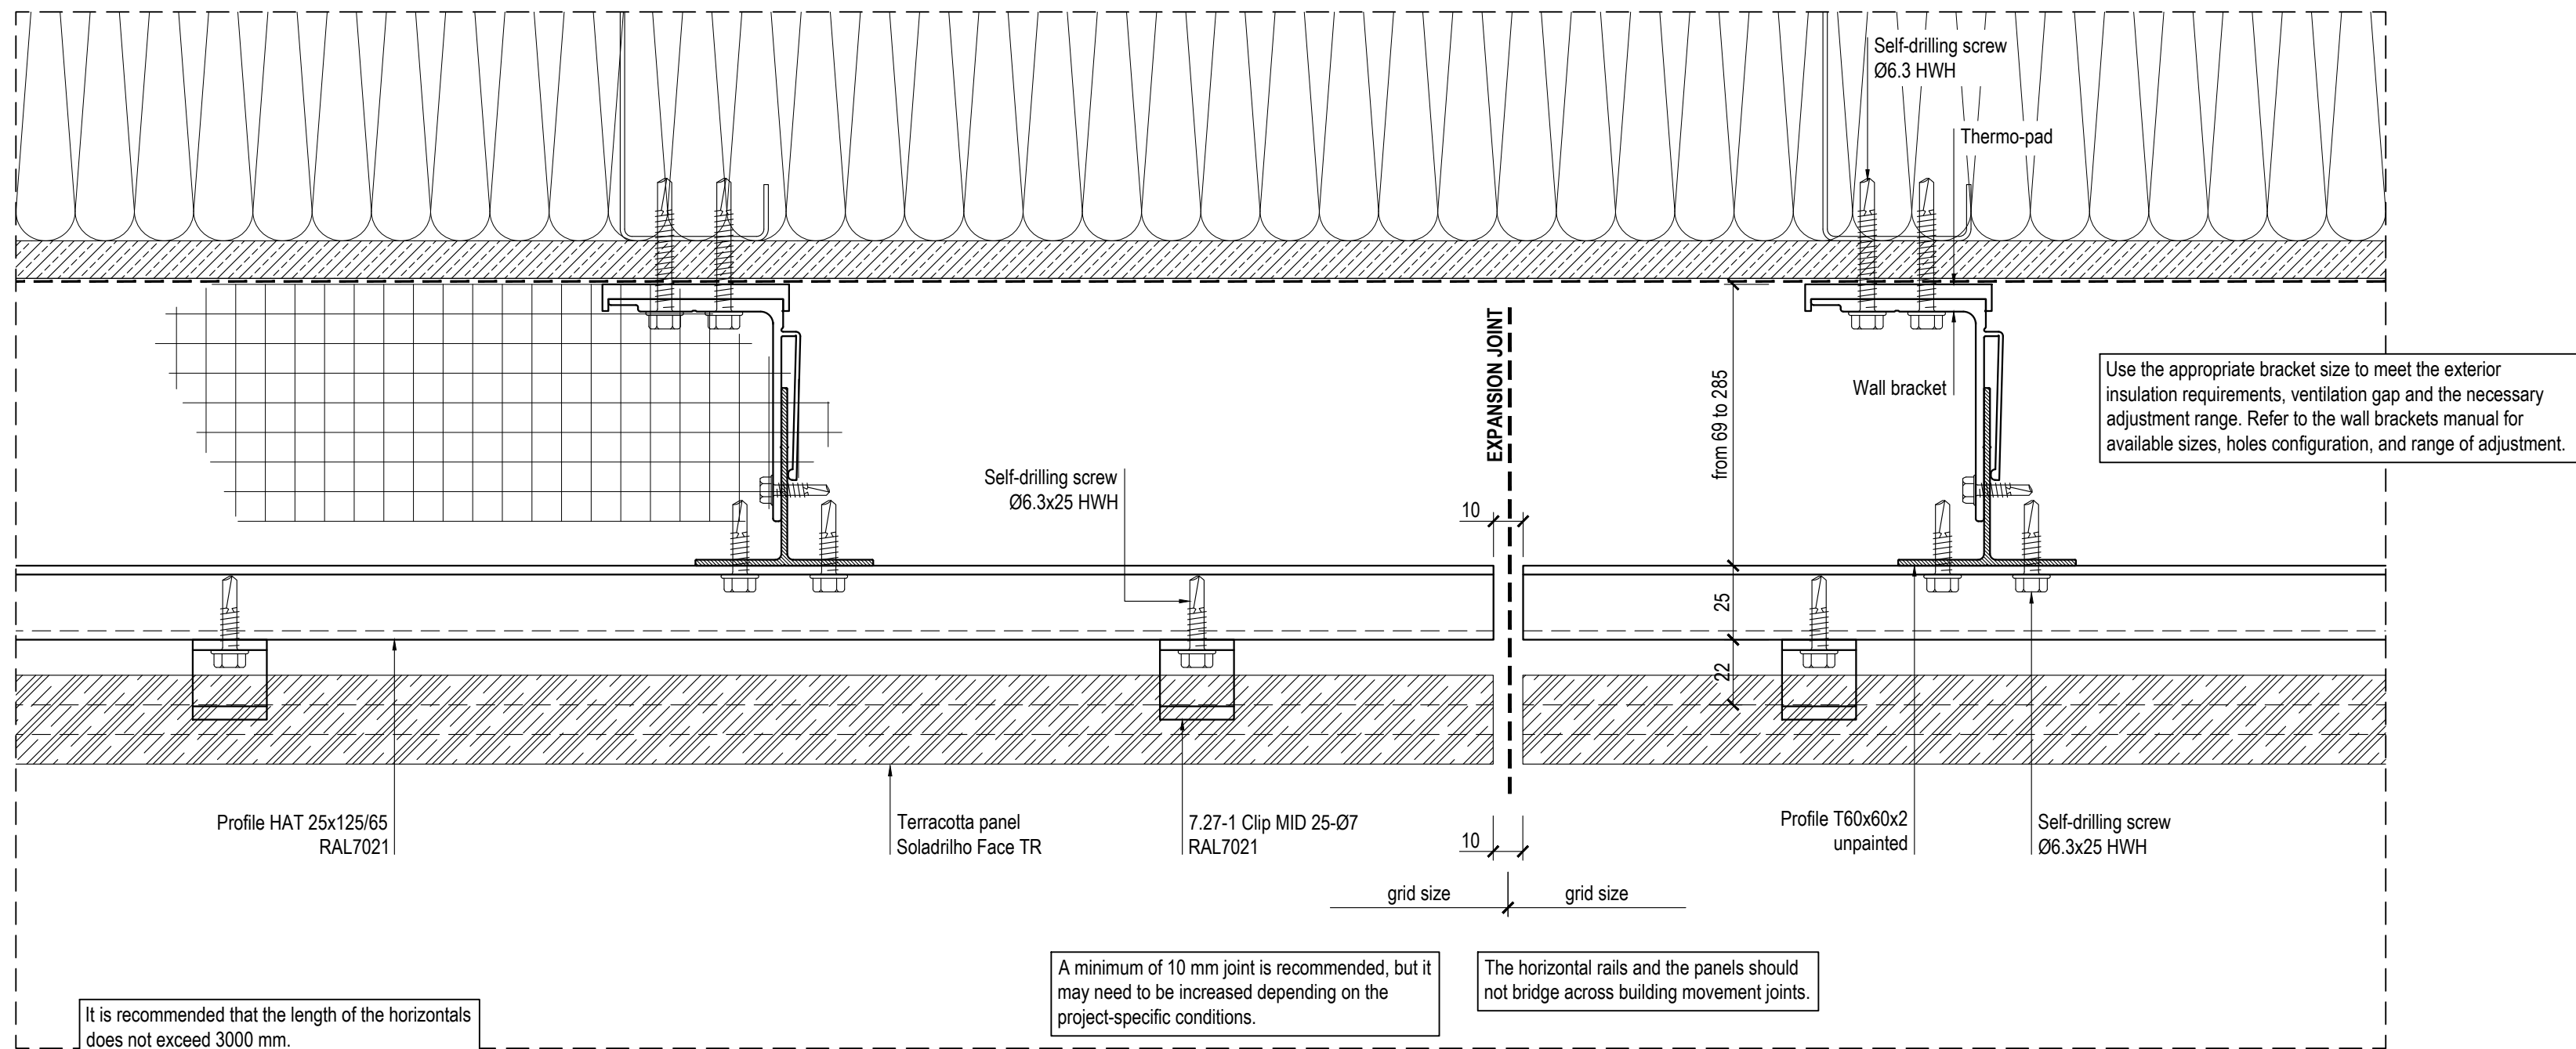

GENERAL NOTES


Movement joints in rails and panels must allow for thermal expansion of the cladding system's components and the movement of the building structure.

The maximum length of the rails, as well as the number and spacing of attachment points should be specified by project-specific calculations.


All fasteners should be 300 series stainless steel or as recommended by the fastener's manufacturer for fasteners exposed to weather.

Minimum spacing and edge distances of fasteners must comply with the applicable codes and manufacturer's requirements, and should be considered in the design.


SECTION DETAIL

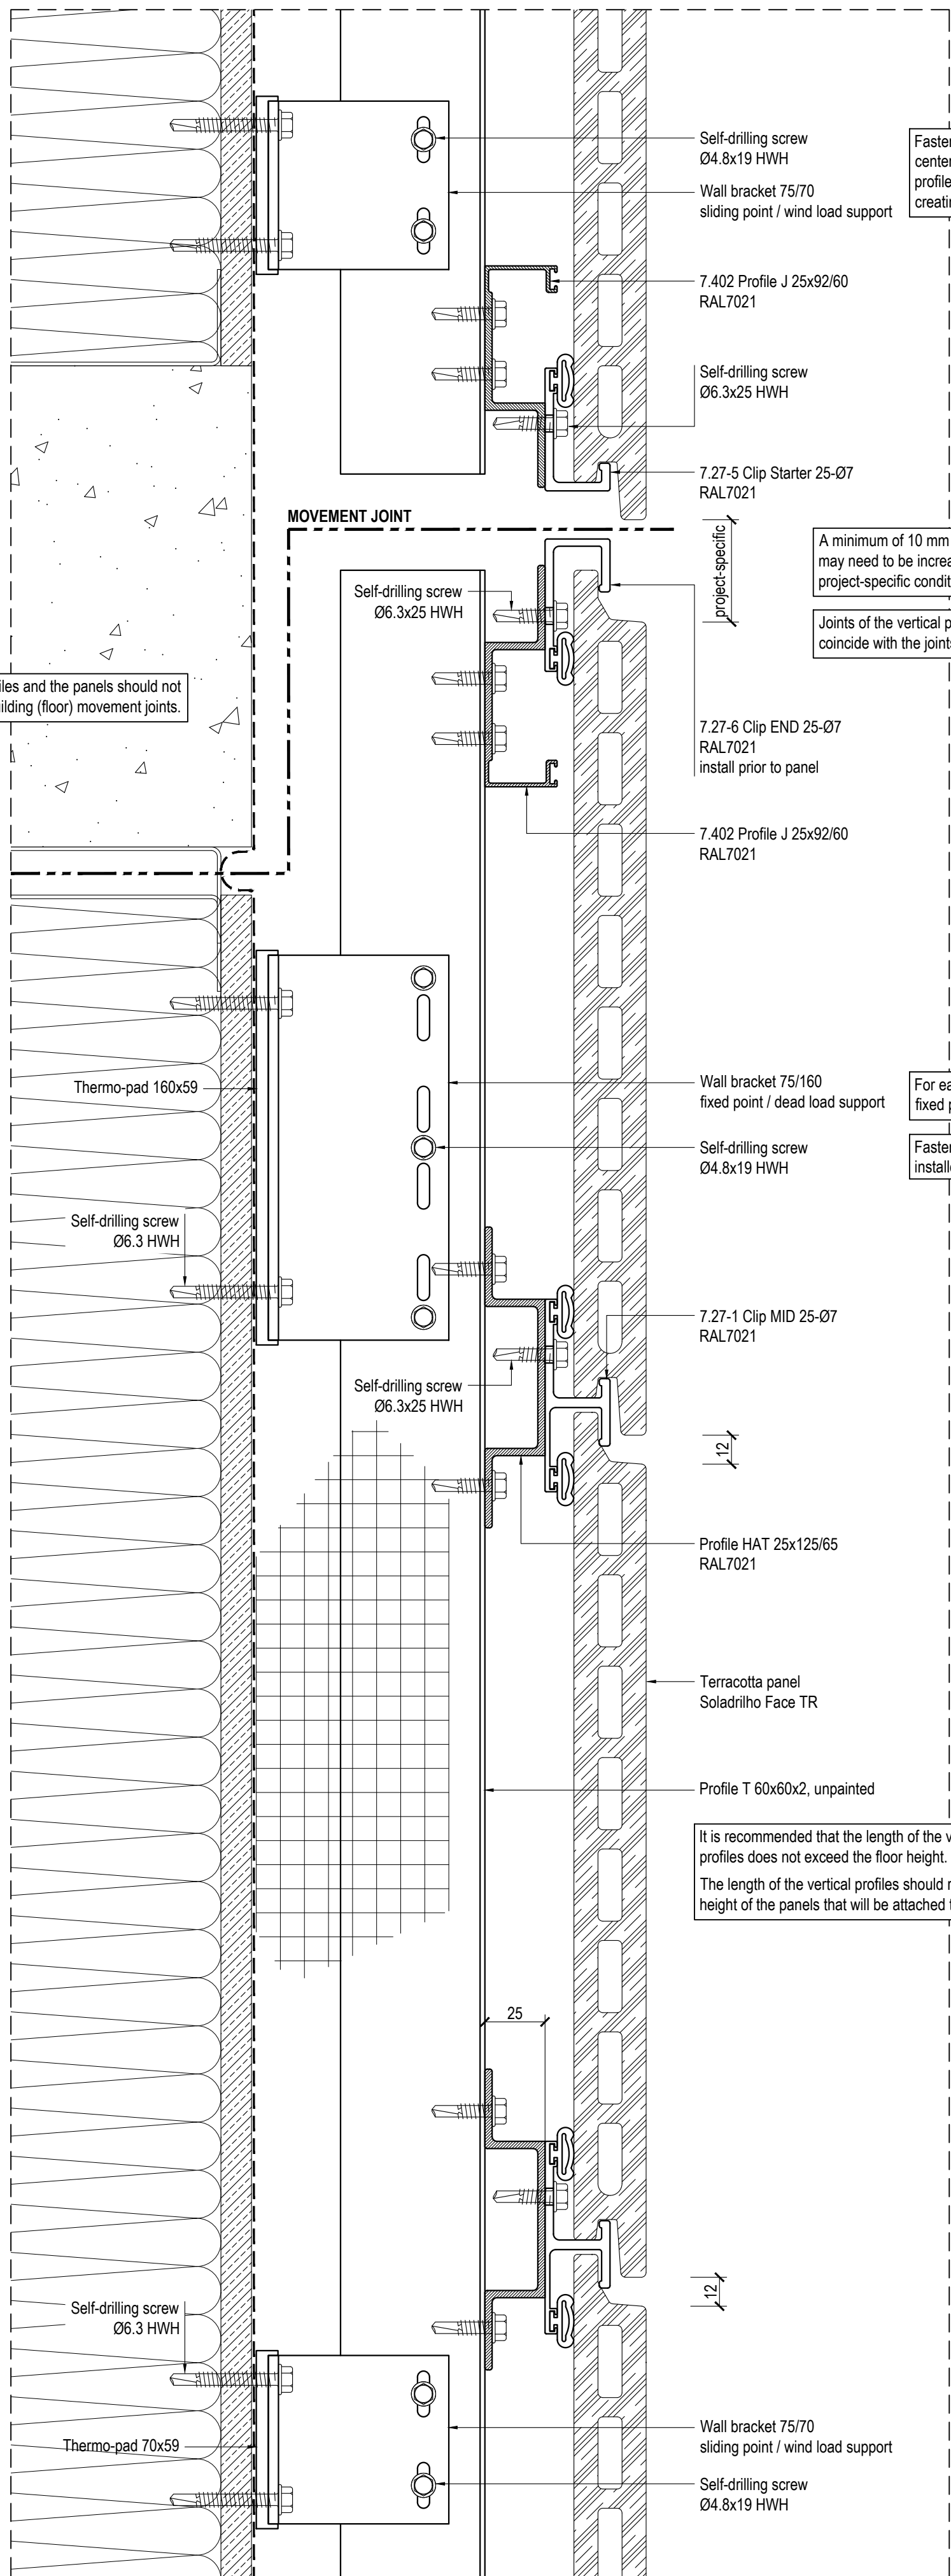


TOP CLIP OPTIONS

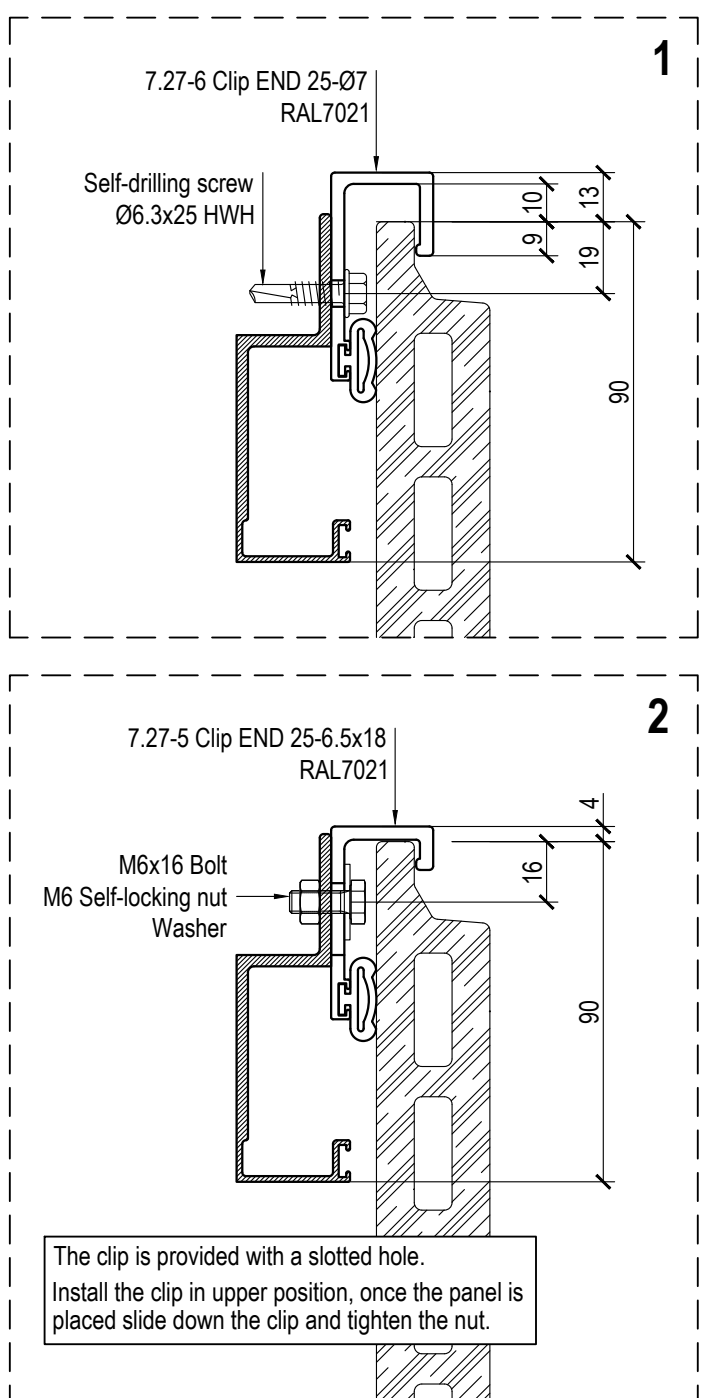


PLAN DETAIL - OUTER CORNER

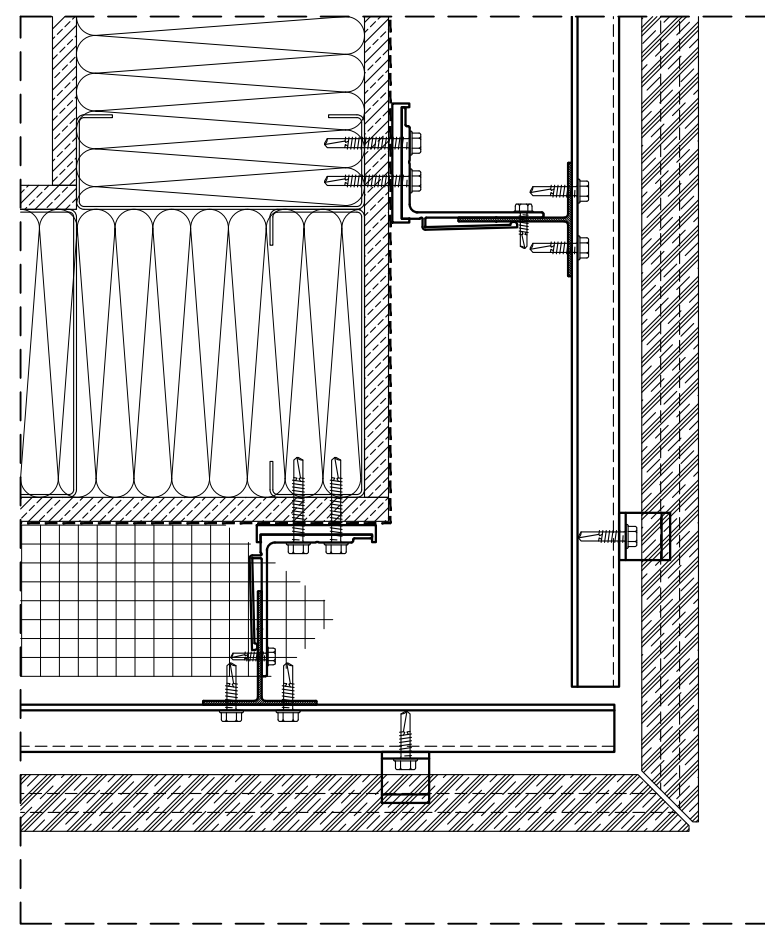


PLAN DETAIL - INNER CORNER

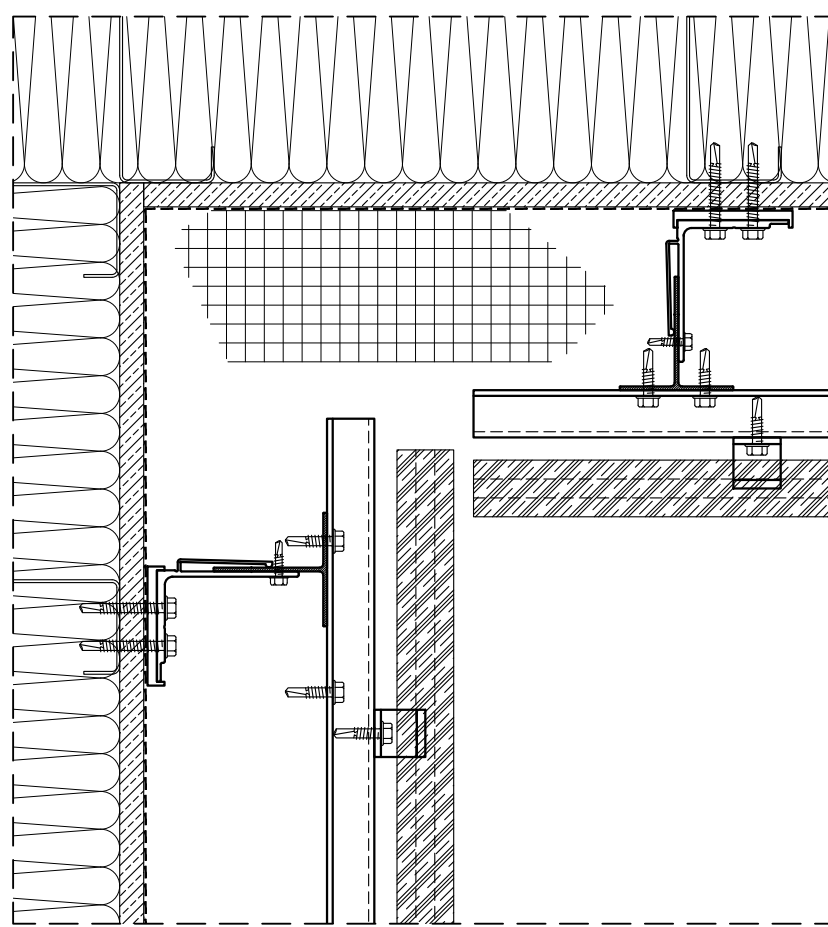

PLAN DETAIL - WINDOW JAMB

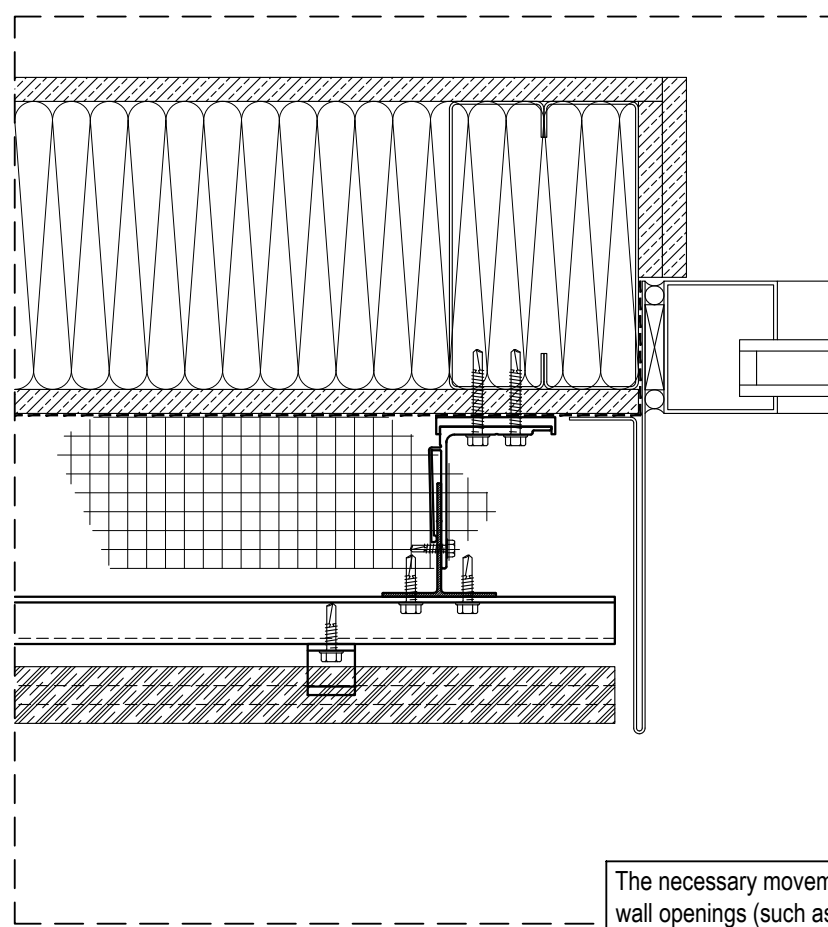


PLAN DETAIL - WINDOW JAMB

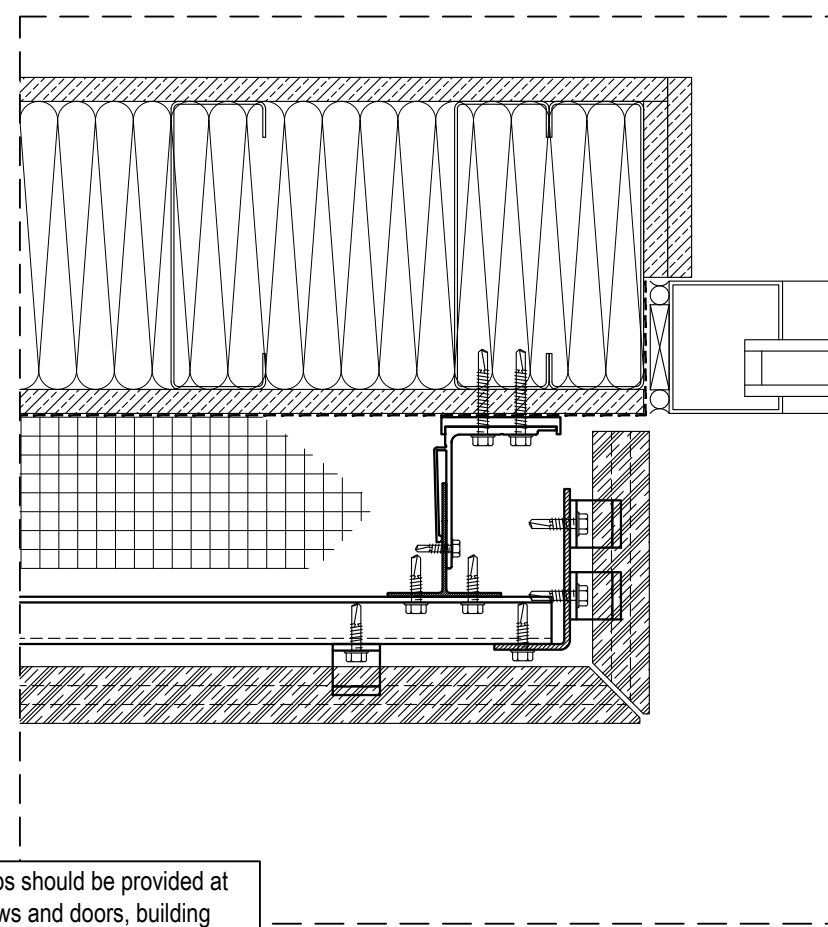


The necessary movement gaps should be provided at wall openings (such as windows and doors, building corners and setbacks, etc.) and adjacent materials.


SECTION DETAIL - BASE

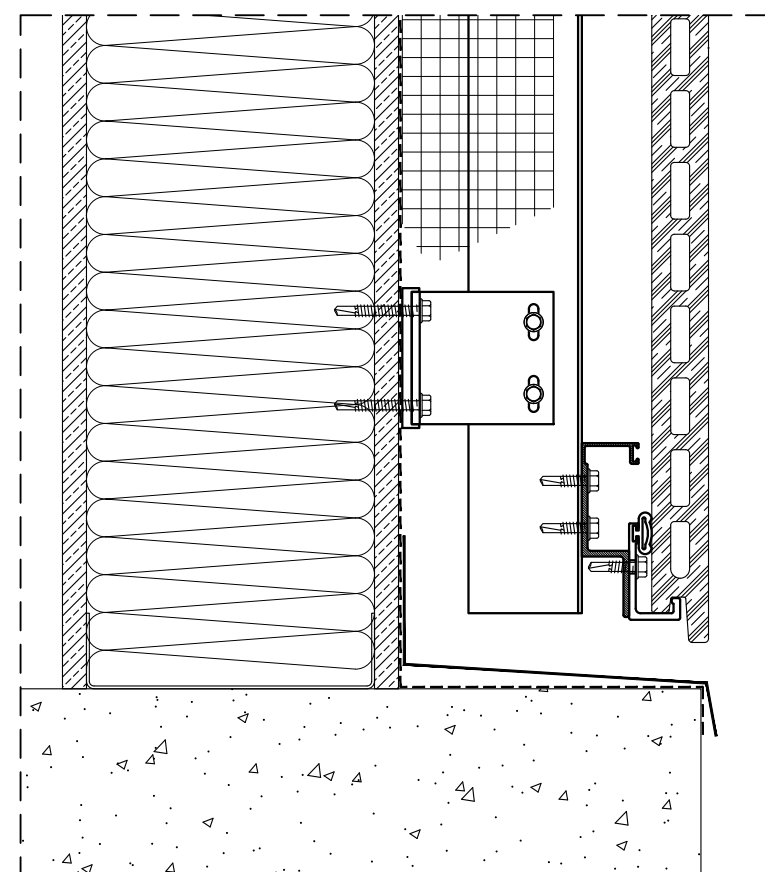

SECTION DETAIL - COPING

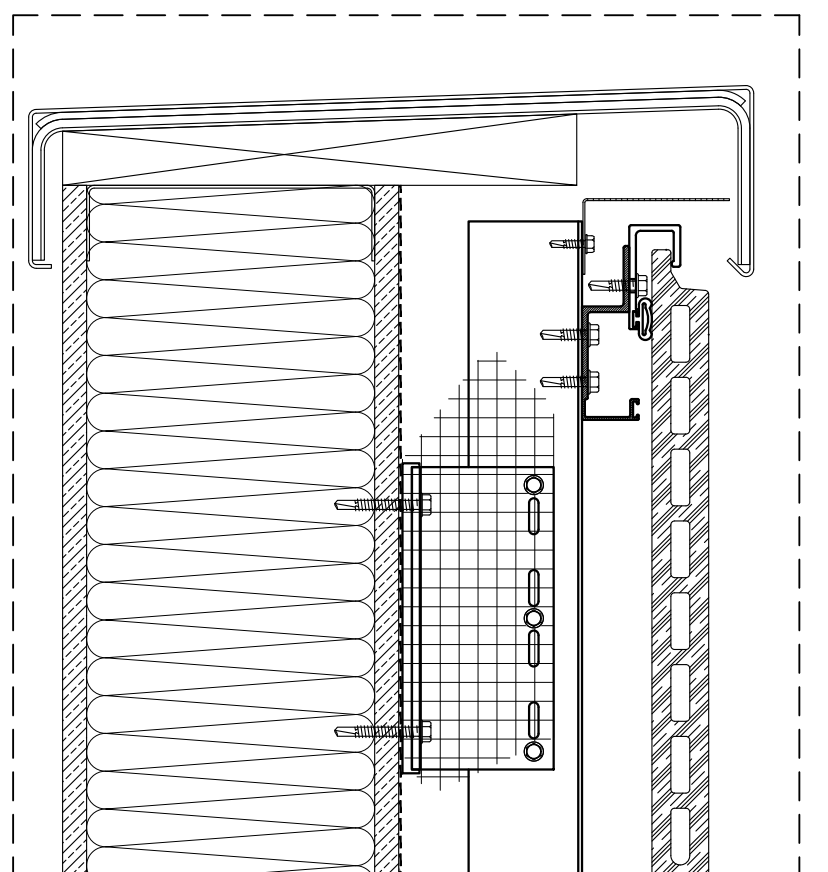

SECTION DETAIL - WINDOW HEAD

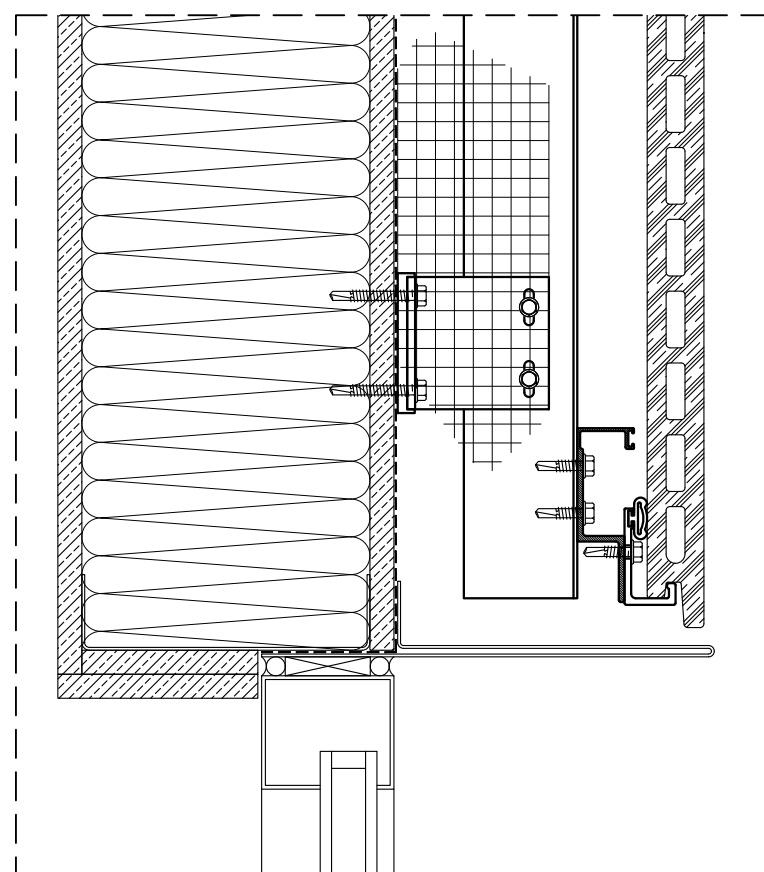

SECTION DETAIL - WINDOW SILL

